

CHAPTER 12

Hydronic Heating and Cooling System Design

Temperature Classifications

CLOSED WATER SYSTEMS

Thermal Components

Hydraulic Components

DESIGN CONSIDERATIONS

Piping Circuits

Capacity Control of Load System

Sizing Control Valves

Low-Temperature Heating Systems

Chilled Water Systems

Dual-Temperature Systems

Other Design Considerations

Design Procedures

Antifreeze Solutions

The preparation of this chapter is assigned to TC 6.1, Hydronic and Steam Equipment and Systems.

WATER systems that convey heat to or from a conditioned space or process with hot or chilled water are frequently called hydronic systems. The water flows through piping that connects a boiler, water heater, or chiller to suitable terminal heat transfer units located at the space or process.

Water systems can be classified by (1) operating temperature, (2) flow generation, (3) pressurization, (4) piping arrangement, and (5) pumping arrangement.

Classified by flow generation, hydronic heating systems may be (1) gravity systems, which use the difference in density between the supply and return water columns of a circuit or system to circulate water; or (2) forced systems, in which a pump, usually driven by an electric motor, maintains the flow. Gravity systems are seldom used today and are therefore not discussed in this chapter. See the *ASHVE Heating Ventilating Air Conditioning Guide* issued prior to 1957 for information on gravity systems.

Water systems can be either once-through or recirculating systems. This chapter describes forced recirculating systems.

Principles

The design of effective and economical water systems is affected by complex relationships between the various system components. The design water temperature, flow rate, piping layout, pump selection, terminal unit selection, and control method are all interrelated. The size and complexity of the system determine the importance of these relationships to the total system operating success. In the United States, present hydronic heating system design practice originated in residential heating applications, where a temperature drop (Δt) of 20°F was used to determine flow rate. Besides producing satisfactory operation and economy in small systems, this Δt enabled simple calculations because 1 gpm conveys 10,000 Btu/h. However, almost universal use of hydronic systems for both heating and cooling of large buildings and building complexes has rendered this simplified approach obsolete.

TEMPERATURE CLASSIFICATIONS

Water systems can be classified by operating temperature as follows.

Low-temperature water (LTW) system. This hydronic heating system operates within the pressure and temperature limits of the ASME *Boiler and Pressure Vessel Code* for low-pressure boilers. The maximum allowable working pressure for low-pressure boilers is 160 psig, with a

maximum temperature limitation of 250°F. The usual maximum working pressure for boilers for LTW systems is 30 psi, although boilers specifically designed, tested, and stamped for higher pressures are frequently used. Steam-to-water or water-to-water heat exchangers are also used for heating low-temperature water. Low-temperature water systems are used in buildings ranging from small, single dwellings to very large and complex structures.

Medium-temperature water (MTW) system. This hydronic heating system operates at temperatures between 250 and 350°F, with pressures not exceeding 160 psi. The usual design supply temperature is approximately 250 to 325°F, with a usual pressure rating of 150 psi for boilers and equipment.

High-temperature water (HTW) system. This hydronic heating system operates at temperatures over 350°F and usual pressures of about 300 psi. The maximum design supply water temperature is usually about 400°F, with a pressure rating for boilers and equipment of about 300 psi. The pressure-temperature rating of each component must be checked against the system's design characteristics.

Chilled water (CW) system. This hydronic cooling system normally operates with a design supply water temperature of 40 to 55°F, usually 44 or 45°F, and at a pressure of up to 120 psi. Antifreeze or brine solutions may be used for applications (usually process applications) that require temperatures below 40°F or for coil freeze protection. Well water systems can use supply temperatures of 60°F or higher.

Dual-temperature water (DTW) system. This hydronic combination heating and cooling system circulates hot and/or chilled water through common piping and terminal heat transfer apparatus. These systems operate within the pressure and temperature limits of LTW systems, with usual winter design supply water temperatures of about 100 to 150°F and summer supply water temperatures of 40 to 45°F.

Terminal heat transfer units include convectors, cast-iron radiators, baseboard and commercial finned-tube units, fan-coil units, unit heaters, unit ventilators, central station air-handling units, radiant panels, and snow-melting panels. A large storage tank may be included in the system to store energy to use when such heat input devices as the boiler or a solar energy collector are not supplying energy.

This chapter covers the principles and procedures for designing and selecting piping and components for low-temperature water, chilled water, and dual-temperature water systems. See Chapter 14 for information on medium- and high-temperature water systems.

CLOSED WATER SYSTEMS

Because most hot and chilled water systems are closed, this chapter addresses only closed systems. The fundamental difference between a closed and an open water system is the interface of the water with a compressible gas (such as air) or an elastic surface (such as a diaphragm). A closed water system is defined as one with no more than one point of interface with a compressible gas or surface. This definition is fundamental to understanding the hydraulic dynamics of these systems. Earlier literature referred to a system with an open or vented expansion tank as an "open" system, but such a system is actually a closed system; the atmospheric interface of the tank simply establishes the system pressure.

An open system, on the other hand, has more than one such interface. For example, a cooling tower system has at least two points of interface: the tower basin and the discharge pipe or nozzles entering the tower. One of the major differences in hydraulics between open and closed systems is that certain hydraulic characteristics of open systems cannot occur in closed systems. For example, in contrast to the hydraulics of an open system, in a closed system (1) flow cannot be motivated by static head differences, (2) pumps do not provide static lift, and (3) the entire piping system is always filled with water.

Basic System

Figure 1 shows the fundamental components of a closed hydronic system. Actual systems generally have additional components such as valves, vents, regulators, etc., but they are not essential to the basic principles underlying the system.

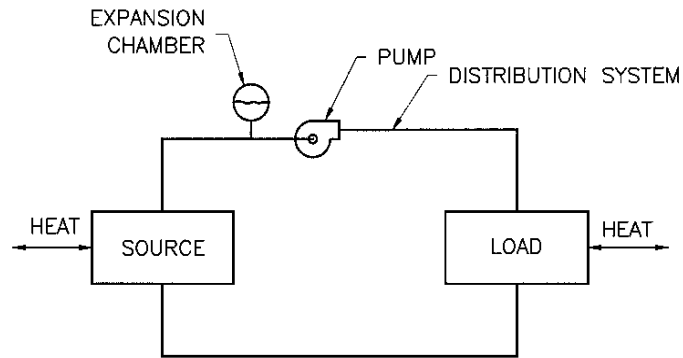


Fig. 1 Hydronic System—Fundamental Components

These fundamental components are

- Loads
- Source
- Expansion chamber
- Pump
- Distribution system

Theoretically, a hydronic system could operate with only these five components.

The components are subdivided into two groups—thermal components and hydraulic components. The thermal components consist of the load, the source, and the expansion chamber. The hydraulic components consist of the distribution system, the pump, and the expansion chamber. The expansion chamber is the only component that serves both a thermal and a hydraulic function.

THERMAL COMPONENTS

Loads

The load is the point where heat flows out of or into the system to or from the space or process; it is the independent variable to which the remainder of the system must respond. Outward heat flow characterizes a heating system, and inward heat flow characterizes a cooling system. The quantity of heating or cooling is calculated by one of the following means.

Sensible Heating or Cooling. The rate of heat entering or leaving an airstream is expressed as follows:

$$q = 60Q_a\rho_a c_p \Delta t \quad (1)$$

where

q = heat transfer rate to or from air, Btu/h

Q_a = airflow rate, cfm

ρ_a = density of air, lb/ft³

c_p = specific heat of air, Btu/lb · °F

Δt = temperature increase or decrease of air, °F

For standard air with a density of 0.075 lb/ft³ and a specific heat of 0.24 Btu/lb · °F, Equation (1) becomes

$$q = 1.08Q_a \Delta t \quad (2)$$

The heat exchanger or coil must then transfer this heat from or to the water. The rate of sensible heat transfer to or from the heated or cooled medium in a specific heat exchanger is a function of the heat transfer surface area; the mean temperature difference between the water and the medium; and the overall heat transfer coefficient, which itself is a function of the fluid velocities, properties of the medium, geometry of the heat transfer surfaces, and other factors. The rate of heat transfer may be expressed by

$$q = UA(\text{LMTD}) \quad (3)$$

where

q = heat transfer rate through heat exchanger, Btu/h

U = overall coefficient of heat transfer, Btu/h·ft²·°F

A = heat transfer surface area, ft²

LMTD=logarithmic mean temperature difference, heated or cooled medium to water, °F

Cooling and Dehumidification. The rate of heat removal from the cooled medium when both sensible cooling and dehumidification are present is expressed by

$$q_t = w\Delta h \quad (4)$$

where

q_t = total heat transfer rate from cooled medium, Btu/h

w = mass flow rate of cooled medium, lb/h

Δh = enthalpy difference between entering and leaving conditions of cooled medium, Btu/lb

Expressed for an air-cooling coil, this equation becomes

$$q_t = 60Q_a \rho_a \Delta h \quad (5)$$

which, for standard air with a density of 0.075 lb/ft³, reduces to

$$q_t = 4.5Q_a \Delta h \quad (6)$$

Heat Transferred to or from Water. The rate of heat transfer to or from the water is a function of the flow rate, the specific heat, and the temperature rise or drop of the water as it passes through the heat exchanger. The heat transferred to or from the water is expressed by

$$q_w = mc_p \Delta t \quad (7)$$

where

q_w = heat transfer rate to or from water, Btu/h

m = mass flow rate of water, lb/h

c_p = specific heat of water, Btu/lb·°F

Δt = water temperature increase or decrease across unit, °F

With water systems, it is common to express the flow rate as volumetric flow, in which case Equation (7) becomes

$$q_w = 8.02\rho_w c_p Q_w \Delta t \quad (8)$$

where

Q_w = water flow rate, gpm

ρ_w = density of water, lb/ft³

For standard conditions in which the density is 62.4 lb/ft³ and the specific heat is 1 Btu/lb·°F, Equation (8) becomes

$$q_w = 500Q_w \Delta t \quad (9)$$

Equation (8) or Equation (9) can be used to express the heat transfer across a single load or source device, or any quantity of such devices connected across a piping system. In the design or diagnosis of a system, the load side may be balanced with the source side using these equations.

Heat Carrying Capacity of Piping. Equation (8) and Equation (9) are also used to express the heat carrying capacity of the piping or distribution system or any portion thereof. The existing temperature differential Δt , sometimes called the temperature range, is identified; for any flow rate Q_w through the piping, q_w is called the *heat carrying capacity*.

Load systems can be any system in which heat is conveyed to or from the water for heating or cooling the space or process. Most load systems are basically a water-to-air finned-coil heat exchanger or a water-to-water exchanger. The specific configuration is usually used to describe the load device. The most common configurations include the following:

Heating load devices

Preheat coils in central units

Heating coils in central units

Zone or central reheat coils

Finned-tube radiators

- Baseboard radiators
- Convectors
- Unit heaters
- Fan-coil units
- Water-to-water heat exchangers
- Radiant heating panels
- Snow-melting panels

Cooling load devices

- Coils in central units
- Fan-coil units
- Induction unit coils
- Radiant cooling panels
- Water-to-water heat exchangers

Source

The source is the point where heat is added to (heating) or removed from (cooling) the system. Ideally, the amount of energy entering or leaving the source equals the amount entering or leaving through the load system(s). Under steady-state conditions, the load energy and source energy are equal and opposite. Also, when properly measured or calculated, temperature differentials and flow rates across the source and loads are all equal. Equation (8) and Equation (9) are used to express the source capacities as well as the load capacities.

Any device that can be used to heat or cool water under controlled conditions can be used as a source device. The most common source devices for heating and cooling systems are the following:
Heating source devices

- Hot water generator or boiler
- Steam-to-water heat exchanger
- Water-to-water heat exchanger
- Solar heating panels
- Heat recovery or salvage heat device, (e.g., water jacket of an internal combustion engine)
- Exhaust gas heat exchanger
- Incinerator heat exchanger
- Heat pump condenser
- Air-to-water heat exchanger

Cooling source devices

- Electric compression chiller
- Thermal absorption chiller
- Heat pump evaporator
- Air-to-water heat exchanger
- Water-to-water heat exchanger

The two primary considerations in selecting a source device are the design capacity and the part-load capability, sometimes called the turndown ratio. The turndown ratio, expressed in percent of design capacity, is

$$\text{Turndown ratio} = 100 \frac{\text{Minimum capacity}}{\text{Design capacity}} \quad (10)$$

The reciprocal of the turndown ratio is sometimes used (for example, a turndown ratio of 25% may also be expressed as a turndown ratio of 4).

The turndown ratio has a significant effect on the performance of a system; lack of consideration of the source system's part-load capability has been responsible for many systems that either do not function properly or do so at the expense of excess energy consumption. The turndown ratio has a significant impact on the ultimate equipment and/or system design selection.

System Temperatures. Design temperatures and temperature ranges are selected by consideration of the performance requirements and the economics of the components. For a cooling system that must maintain 50% rh at 75°F, the dew-point temperature is 55°F, which sets the

maximum return water temperature at something near 55°F (60°F maximum); on the other hand, the lowest practical temperature for refrigeration, considering the freezing point and economics, is about 40°F. This temperature spread then sets constraints for a chilled water system. For a heating system, the maximum hot water temperature is normally established by the ASME Low-Pressure Code as 250°F, and with space temperature requirements of little over 75°F, the actual operating supply temperatures and the temperature ranges are set by the design of the load devices. Most economic considerations relating to the distribution and pumping systems favor the use of the maximum possible temperature range Δt .

Expansion Chamber

The expansion chamber (also called an expansion or compression tank) serves both a thermal function and a hydraulic function. In its thermal function the tank provides a space into which the noncompressible liquid can expand or from which it can contract as the liquid undergoes volumetric changes with changes in temperature. To allow for this expansion or contraction, the expansion tank provides an interface point between the system fluid and a compressible gas. *Note:* By definition, a closed system can have only one such interface; thus, a system designed to function as a closed system can have only one expansion chamber.

Expansion tanks are of three basic configurations: (1) a closed tank, which contains a captured volume of compressed air and water, with an air water interface (sometimes called a plain steel tank); (2) an open tank (i.e., a tank open to the atmosphere); and (3) a diaphragm tank, in which a flexible membrane is inserted between the air and the water (another configuration of a diaphragm tank is the bladder tank).

In the plain steel tank and the open tank, gases can enter the system water through the interface and can adversely affect system performance. Thus, current design practice normally employs diaphragm tanks.

Sizing the tank is the primary thermal consideration in incorporating a tank into a system. However, prior to sizing the tank, the control or elimination of air must be considered. The amount of air that will be absorbed and can be held in solution with the water is expressed by Henry's equation (Pompei 1981):

$$x = p/H \quad (11)$$

where

x = solubility of air in water (% by volume)

p = absolute pressure

H = Henry's constant

Henry's constant, however, is constant only for a given temperature (Figure 2). Combining the data of Figure 2 (Himmelblau 1960) with Equation (11) results in the solubility diagram of Figure 3. With that diagram, the solubility can be determined if the temperature and pressure are known.

If the water is not saturated with air, it will absorb air at the air/water interface until the point of saturation has been reached. Once absorbed, the air will move throughout the body of water either by mass migration or by molecular diffusion until the water is uniformly saturated. If the air/water solution changes to a state that reduces solubility, the excess air will be released as a gas. For example, if the air/water interface is at a high pressure point, the water will absorb air to its limit of solubility at that point; if at another point in the system the pressure is reduced, some of the dissolved air will be released.

In the design of systems with open or plain steel expansion tanks, it is common practice to utilize the tank as the major air control or release point in the system.

Equations for sizing the three common configurations of expansion tanks follow (Coad 1980b):

For closed tanks with air/water interface,

$$V_t = V_s \frac{[(v_2/v_1) - 1] - 3\alpha\Delta t}{(P_a/P_1) - (P_a/P_2)} \quad (12)$$

For open tanks with air/water interface,

$$V_t = 2\{V_s[(v_2/v_1) - 1] - 3\alpha\Delta t\} \quad (13)$$

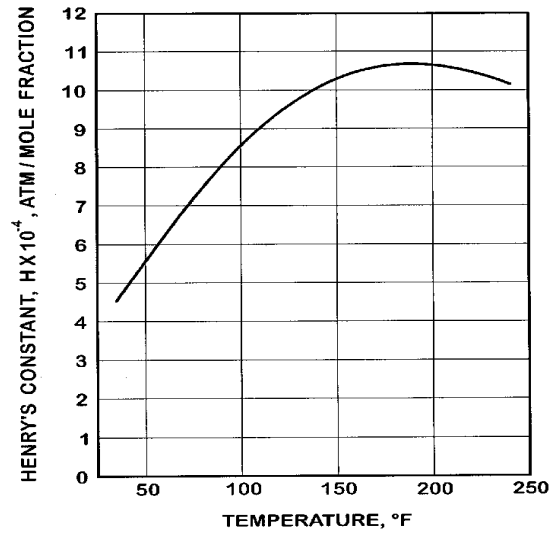


Fig. 2 Henry's Constant Versus Temperature for Air and Water
(Coad 1980a)

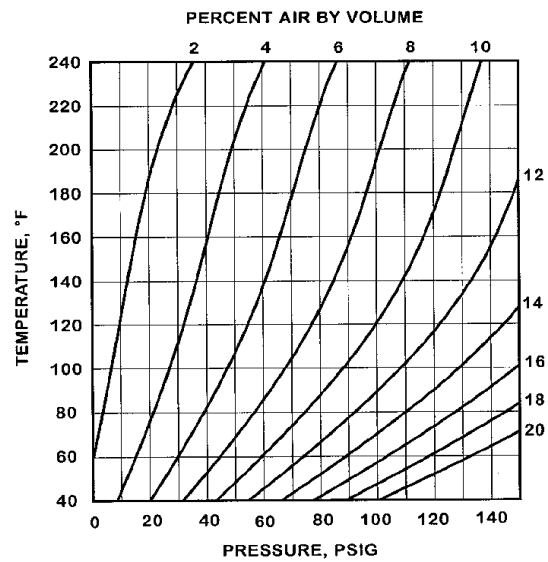


Fig. 3 Solubility Versus Temperature and Pressure for Air/Water Solutions
(Coad 1980a)

For diaphragm tanks,

$$V_t = V_s \frac{[(v_2/v_1) - 1] - 3\alpha\Delta t}{1 - (P_1/P_2)} \quad (14)$$

where

V_t = volume of expansion tank, gal

V_s = volume of water in system, gal

t_1 = lower temperature, °F

t_2 = higher temperature, °F

P_a = atmospheric pressure, psia

P_1 = pressure at lower temperature, psia

P_2 = pressure at higher temperature, psia

v_1 = specific volume of water at lower temperature, ft³/lb

v_2 = specific volume of water at higher temperature, ft³/lb

α = linear coefficient of thermal expansion, in/in \cdot $^{\circ}$ F

= 6.5×10^{-6} in/in \cdot $^{\circ}$ F for steel

= 9.5×10^{-6} in/in \cdot $^{\circ}$ F for copper

$\Delta t = (t_2 - t_1)$, $^{\circ}$ F

As an example, the lower temperature for a heating system is usually normal ambient temperature at fill conditions (e.g., 50 $^{\circ}$ F) and the higher temperature is the operating supply water temperature for the system. For a chilled water system, the lower temperature is the design chilled water supply temperature, and the higher temperature is ambient temperature (e.g., 95 $^{\circ}$ F). For a dual-temperature hot/chilled system, the lower temperature is the chilled water design supply temperature, and the higher temperature is the heating water design supply temperature.

For specific volume and saturation pressure of water at various temperatures, see Table 3 in Chapter 6 of the 1993 *ASHRAE Handbook—Fundamentals*.

At the tank connection point, the pressure in closed tank systems increases as the water temperature increases. Pressures at the expansion tank are generally set by the following parameters:

- The lower pressure is usually selected to hold a positive pressure at the highest point in the system (usually about 10 psig).
- The higher pressure is normally set by the maximum pressure allowable at the location of the safety relief valve(s) without opening them.

Other considerations are to ensure that (1) the pressure at no point in the system will ever drop below the saturation pressure at the operating system temperature and (2) all pumps have sufficient net positive suction head (NPSH) available to prevent cavitation.

Example 1. Size an expansion tank for a heating water system that will be operated at a design temperature range of 180 to 220 $^{\circ}$ F. The minimum pressure at the tank is 10 psig (24.7 psia) and the maximum pressure is 25 psig (39.7 psia). (Atmospheric pressure is 14.7 psia.) The volume of water is 3000 gal. The piping is steel.

1. Calculate the required size for a closed tank with an air/water interface.

Solution: For lower temperature t_1 , use 40 $^{\circ}$ F.

From Table 3 in Chapter 6 of the 1993 *ASHRAE Handbook—Fundamentals*,

$$v_1(\text{at } 40^{\circ}\text{F}) = 0.01602 \text{ ft}^3/\text{lb}$$

$$v_2(\text{at } 220^{\circ}\text{F}) = 0.01677 \text{ ft}^3/\text{lb}$$

Using Equation (12),

$$V_t = 3000 \times \frac{[(0.01677/0.01602) - 1] - 3(6.5 \times 10^{-6})(220 - 40)}{(14.7/24.7) - (14.7/39.7)}$$
$$V_t = 578 \text{ gal}$$

If a diaphragm tank were to be used in lieu of the plain steel tank, what tank size would be required?

Solution: Using Equation (14),

$$V_t = 3000 \times \frac{[(0.01677/0.01602) - 1] - 3(6.5 \times 10^{-6})(220 - 40)}{1 - (24.7/39.7)}$$
$$V_t = 344 \text{ gal}$$

HYDRAULIC COMPONENTS

Distribution System

The distribution system is the piping system connecting the various other components of the system. The primary considerations in designing this system are (1) sizing the piping to handle the heating or cooling capacity required and (2) arranging the piping to ensure flow in the quantities required at design conditions and at all other loads.

The flow requirement of the pipe is determined by Equation (8) or Equation (9). After Δt is established based on the thermal requirements, either of these equations (as applicable) can be used to determine the flow rate. First-cost economics and energy consumption make it advisable to design for the greatest practical Δt because the flow rate is inversely proportional to Δt ; that is, if Δt doubles, the flow rate is reduced by half.

The three related variables in sizing the pipe are flow rate, pipe size, and pressure drop. The primary consideration in selecting a design pressure drop is the relationship between the economics of first cost and energy costs.

Once the distribution system is designed, the pressure loss at design flow is calculated by the methods discussed in Chapter 33 of the 1993 *ASHRAE Handbook—Fundamentals*. The relationship between flow rate and pressure loss can be expressed by

$$Q = C_v \sqrt{\Delta p} \quad (15)$$

where

Q = system flow rate, gpm

Δp = pressure drop in system, psi

C_v = system constant (sometimes called valve coefficient, which is discussed in Chapter 41)

Equation (15) may be modified as follows:

$$Q = C_s \sqrt{\Delta h} \quad (16)$$

where

Δh = system head loss, ft of fluid [$\Delta h = \Delta p / \rho$]

C_s = system constant [$C_s = 0.67 C_v$ for water with a density $\rho = 62.4 \text{ lb/ft}^3$]

Equation (15) and Equation (16) are the system constant form of the Darcy-Weisbach equation. If the flow rate and head loss are known for a system, Equation (16) may be used to calculate the system constant C_v . From this calculation, the pressure loss can be determined at any other flow rate. Equation (16) can be graphed as a system curve (Figure 4).

The system curve changes if anything occurs that changes the flow/pressure drop characteristics. Examples of this are a strainer that starts to block or a control valve closing, either of which increases the head loss at any given flow rate, thus changing the system curve in a direction from curve A to curve B in Figure 4.

Pump or Pumping System

Centrifugal pumps are the type most commonly used in hydronic systems (see Chapter 38). Circulating pumps used in water systems can vary in size from small in-line circulators delivering 5 gpm at 6 or 7 ft head to base-mounted or vertical pumps handling hundreds or thousands of gallons per minute, with pressures limited only by the characteristics of the system. Pump operating characteristics must be carefully matched to system operating requirements.

Pump Curves and Water Temperature. Performance characteristics of centrifugal pumps are described by pump curves, which plot flow versus head or pressure, as well as by efficiency and power information. The point at which a pump operates is the point at which the pump curve intersects the system curve (Figure 5).

A complete piping system follows the same water flow/pressure drop relationships as any component of the system [see Equation (16)]. Thus, the pressure required for any proposed flow rate through the system may be determined and a system curve constructed. A pump may be selected by using the calculated system pressure at the design flow rate as the base point value.

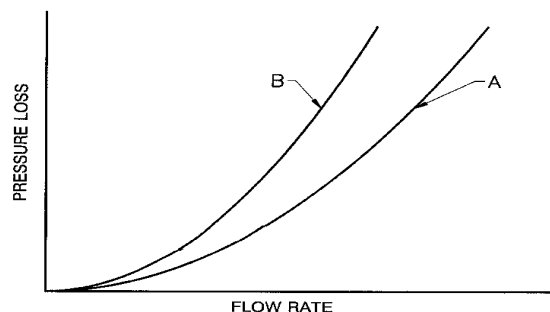


Fig. 4 Typical System Curves for Closed System

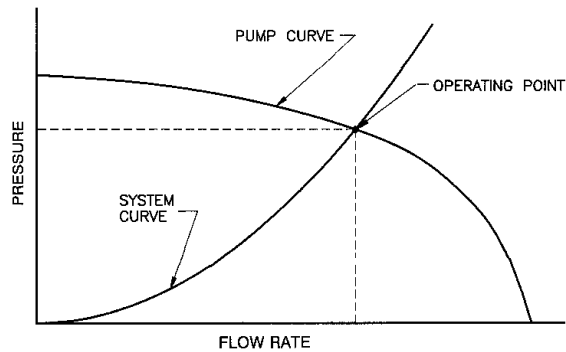


Fig. 5 Pump Curve and System Curve

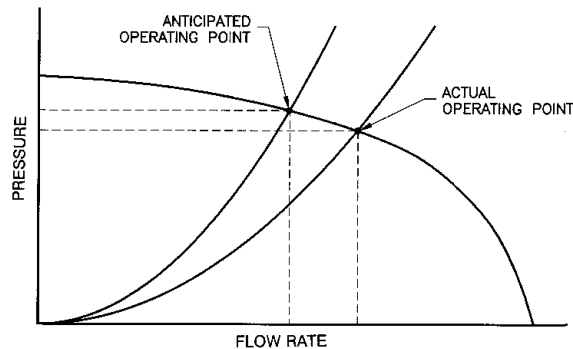


Fig. 6 Shift of System Curve due to Circuit Unbalance

Figure 6 illustrates how a shift of the system curve to the right affects system flow rate. This shift can be caused by incorrectly calculating the system pressure drop by using arbitrary safety factors or overstated pressure drop charts. Variable system flow caused by control valve operation or improperly balanced systems (subcircuits having substantially lower pressure drops than the longest circuit) can also cause a shift to the right.

As described in Chapter 38, pumps for closed-loop piping systems should have a flat pressure characteristic and should operate slightly to the left of the peak efficiency point on their curves. This characteristic permits the system curve to shift to the right without causing undesirable pump operation, overloading, or reduction in available pressure across circuits with large pressure drops.

Many dual-temperature systems are designed so that the chillers are bypassed during the winter months. The chiller pressure drop, which may be quite high, is thus eliminated from the system pressure drop, and the pump shift to the right may be quite large. For such systems, system curve analysis should be used to check winter operating points.

Operating points may be highly variable, depending on (1) load conditions, (2) the types of control valves used, and (3) the piping circuitry and heat transfer elements. In general, the best selection will be

- For design flow rates calculated using pressure drop charts that illustrate actual closed-loop hydronic system piping pressure drops
- To the left of the maximum efficiency point of the pump curve to allow shifts to the right caused by system circuit unbalance, direct-return circuitry applications, and modulating three-way valve applications
- A pump with a flat curve to compensate for unbalanced circuitry and to provide a minimum pressure differential increase across two-way control valves

Parallel Pumping. When pumps are applied in parallel, each pump operates at the same head, and provides its share of the system flow at that pressure (Figure 7). Generally, pumps of equal size are used, and the parallel pump curve is established by doubling the flow of the single pump curve (with identical pumps).

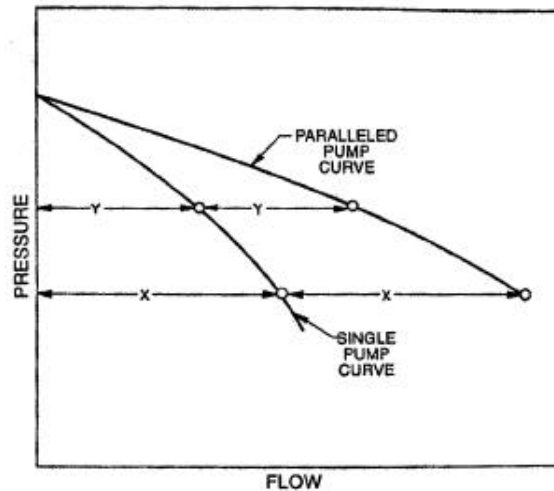


Fig. 7 Operating Conditions for Parallel Pump Installation

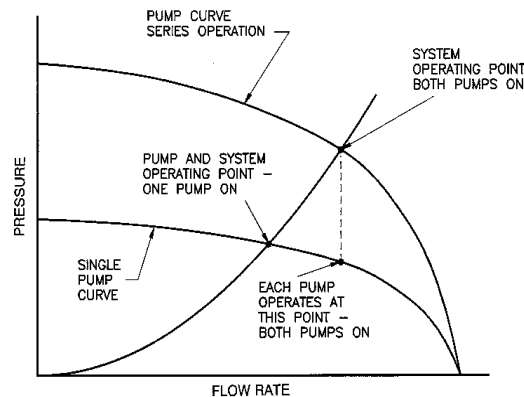


Fig. 8 Operating Conditions for Series Pump Installation

Plotting a system curve across the parallel pump curve shows the operating points for both single and parallel pump operation (Figure 7). Note that single pump operation does not yield 50% flow. The system curve crosses the single pump curve considerably to the right of its operating point when both pumps are running. This leads to two important concerns: (1) the pumps must be powered to prevent overloading during single-pump operation, and (2) a single pump can provide standby service of up to 80% of design flow; the actual amount depends on the specific pump curve and system curve.

Series Pumping. When pumps are operated in series, each pump operates at the same flow rate and provides its share of the total pressure at that flow. A system curve plotted across the series pump curve shows the operating points for both single and series pump operation (Figure 8). Note that the single pump can provide up to 80% flow for standby and at a lower power requirement.

Series pump installations are often used in heating and cooling systems so that both pumps operate during the cooling season to provide maximum flow and head, while only a single pump operates during the heating season. Note that both parallel and series pump applications require that the actual pump operating points be used to accurately determine the pumping point. Adding artificial safety factor head, using improper pressure drop charts, or incorrectly calculating pressure drops may lead to an unwise selection.

Multiple-Pump Systems. Care must be taken in designing systems with multiple pumps to ensure that if pumps ever operate in either parallel or series, such operation is fully understood and considered by the designer. Pumps performing unexpectedly in series or parallel have been the

cause of performance problems in hydronic systems. Typical problems resulting from pumps functioning in parallel and series when not anticipated by the designer are the following.

Parallel. With pumps of unequal pressures, one pump may create a pressure across the other pump in excess of its cutoff pressure, causing flow through the second pump to diminish significantly or to cease. This phenomenon can cause flow problems or pump damage.

Series. With pumps of different flow capacities, the pump of greater capacity may overflow the pump of lesser capacity, which could cause damaging cavitation in the smaller pump and could actually cause a pressure drop rather than a pressure rise across that pump. In other circumstances, unexpected series operation can cause excessively high or low pressures that can damage system components.

Standby Pump Provision. If total flow standby capacity is required, a properly valved standby pump of equal capacity is installed to operate when the normal pump is inoperable. A single standby may be provided for several similarly sized pumps. Parallel or series pump installation can provide up to 80% standby, which is often sufficient.

Compound Pumping. In larger systems, compound pumping, also known as primary-secondary pumping, is often employed to provide system advantages that would not be available with a single pumping system. The concept of compound pumping is illustrated in Figure 9.

In Figure 9, Pump No. 1 can be referred to as the source or primary pump and Pump No. 2 as the load or secondary pump. The short section of pipe between A and B is called the common pipe because it is common to both the source and load circuits. Other terms used for the common pipe are the decoupling line and the neutral bridge. In the design of compound systems, the common pipe should be kept as short and as large in diameter as practical to minimize the pressure loss between those two points. Care must be taken, however, to ensure adequate length in the common pipe to prevent recirculation from entry or exit turbulence. There should never be a valve or check valve in the common pipe. If these conditions are met and the pressure loss in the common pipe can be assumed to be zero, then neither pump will affect the other. Then, except for the system static pressure at any given point, the circuits can be designed and analyzed and will function dynamically independently of one another.

In Figure 9, if Pump No. 1 has the same flow capacity in its circuit as Pump No. 2 has in its circuit, all of the flow entering Point A from Pump No. 1 will leave in the branch supplying Pump No. 2, and no water will flow in the common pipe. Under this condition, the water entering the load will be at the same temperature as that leaving the source.

If the flow capacity of Pump No. 1 exceeds that of Pump No. 2, some water will flow downward in the common pipe. Under this condition, Tee A is a diverting tee, and Tee B becomes a mixing tee. Again, the temperature of the fluid entering the load is the same as that leaving the source. However, because of the mixing taking place at Point B, the temperature of the water returning to the source is between the source supply temperature and the load return temperature.

On the other hand, if the flow capacity of Pump No. 1 is less than that of Pump No. 2, then Point A becomes a mixing point because some water must recirculate upward in the common pipe from Point B. Under this condition, the temperature of the water entering the load is between the supply water temperature from the source and the return water temperature from the load.

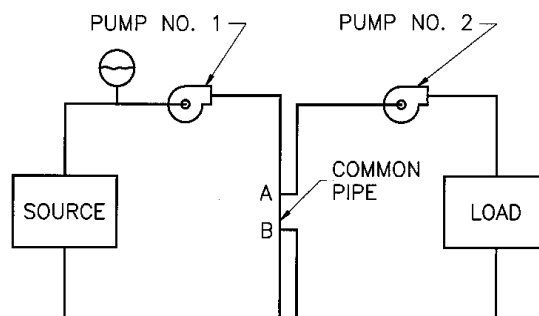


Fig. 9 Compound Pumping (Primary-Secondary Pumping)

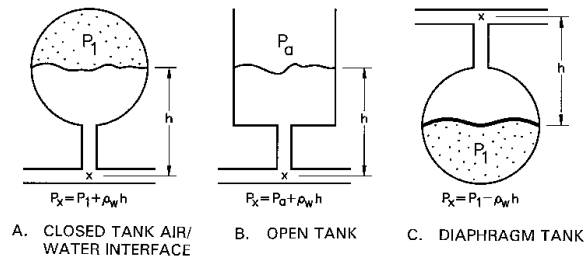


Fig. 10 Tank Pressure Related to "System" Pressure

For example, if Pump No. 1 circulates 25 gpm of water leaving the source at 200°F, and Pump No. 2 circulates 50 gpm of water leaving the load at 100°F, then the water temperature entering the load is

$$t_{load} = 200 - (25/50)(200 - 100) = 150^{\circ}\text{F}$$

The following are some advantages of compound circuits:

1. They enable the designer to achieve different water temperatures and temperature ranges in different elements of the system.
2. They decouple the circuits hydraulically, thereby making the control, operation, and analysis of large systems much less complex. Hydraulic decoupling also prevents unwanted series or parallel operation.
3. Circuits can be designed for different flow characteristics. For example, a chilled water load system can be designed with two-way valves for better control and energy conservation while the source system operates at constant flow to protect the chiller from freezing.

Expansion Chamber

As a hydraulic device, the expansion tank serves as the reference pressure point in the system, analogous to a ground in an electrical system (Lockhart and Carlson 1953). Where the tank connects to the piping, the pressure equals the pressure of the air in the tank plus or minus any fluid pressure due to the elevation difference between the tank liquid surface and the pipe (Figure 10).

As previously stated, a closed system should have only one expansion chamber. The presence of more than one chamber or of excessive amounts of undissolved air in a piping system can cause the closed system to behave in unexpected (but understandable) ways, causing extensive damage from shock waves or water hammer.

With a single chamber on a system, assuming isothermal conditions for the air, the air pressure can change only as a result of displacement by the water. The only thing that can cause the water to move into or out of the tank (assuming no water is being added to or removed from the system) is expansion or shrinkage of the water in the system. Thus, in sizing the tank, thermal expansion is related to the pressure extremes of the air in the tank [Equation (12), Equation (13), and Equation (14)].

The point of connection of the tank should be based on the pressure requirements of the system, remembering that the pressure at the tank connection will not change as the pump is turned on or off. For example, consider a system containing an expansion tank at 30 psig and a pump with a pump head of 23.1 ft (10 psig). Figure 11 shows alternative locations for connecting the expansion tank; in either case, with the pump off, the pressure will be 30 psig on both the pump suction and discharge. With the tank on the pump suction side, when the pump is turned on, the pressure increases on the discharge side by an amount equal to the pump pressure (Figure 11A). With the tank connected on the discharge side of the pump, the pressure decreases on the suction side by the same amount (Figure 11B).

Other considerations relating to the tank connection include the following:

- A tank open to the atmosphere must be located above the highest point in the system.
- A tank with an air/water interface is generally used with an air control system that continually revents the air into the tank. For this reason, it should be connected at a point where air can best be released.

- Within reason, the lower the pressure in a tank, the smaller is the tank [see Equation (12) and Equation (14)]. Thus, in a vertical system, the higher the tank is placed, the smaller it can be.

DESIGN CONSIDERATIONS

PIPING CIRCUITS

Hydronic systems are designed with many different configurations of piping circuits. In addition to simple preference by the design engineer, the method of arranging the circuiting can be dictated by such factors as the shape or configuration of the building, the economics of installation, energy economics, the nature of the load, part-load capabilities or requirements, and others.

Each piping system is a network; the more extensive the network, the more complex it is to understand, analyze, or control. Thus, a major design objective is to maintain the highest degree of simplicity.

Load distribution circuits are of four general types:

- Full series
- Diverting series
- Parallel direct return
- Parallel reverse return

Series Circuit. A simple series circuit is shown in Figure 12. Series loads generally have the advantage of both lower piping costs and higher temperature drops that result in smaller pipe sizes and lower energy consumption. A disadvantage is that the different circuits cannot be controlled separately. Simple series circuits are generally limited to residential and small commercial standing radiation systems. Figure 13 shows a typical layout of such a system with two zones for residential or small commercial heating.

Diverting Series. The simplest diverting series circuit diverts some of the flow from the main piping circuit through a special diverting tee to a load device (usually standing radiation) that has a

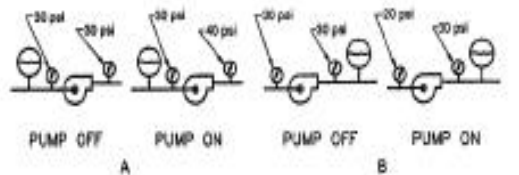


Fig. 11 Effect of Expansion Tank Location with Respect to Pump Pressure

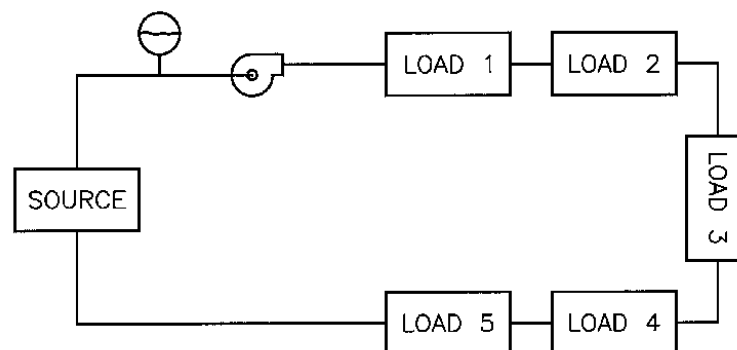


Fig. 12 Flow Diagram of Simple Series Circuit

low pressure drop. This system is generally limited to heating systems in residential or small commercial applications.

Figure 14 illustrates a typical one-pipe diverting tee circuit. For each terminal unit, a supply and a return tee are installed on the main. One of the two tees is a special diverting tee that creates a pressure drop in the main flow to divert part of the flow to the unit. One (return) diverting tee is usually sufficient for upfeed (units above the main) systems. Two special fittings (supply and return tees) are usually required to overcome thermal pressure in downfeed units. Special tees are proprietary; consult manufacturer's literature for flow rates and pressure drop data on these devices. Unit selection can be only approximate without these data.

One-pipe diverting series circuits allow manual or automatic control of flow to individual heating units. On-off rather than flow modulation control is preferred because of the relatively low pressure drop allowable through the control valve in the diverted flow circuit. This system is likely to cost more than the series loop because extra branch pipe and fittings, including special tees, are required. Each unit usually requires a manual air vent because of the low water velocity through the unit. The length and load imposed on a one-pipe circuit are usually small because of these limitations.

Because only a fraction of the main flow is diverted in a one-pipe circuit, the flow rate and pressure drop are less variable as water flow to the load is controlled than in some other circuits. When two or more one-pipe circuits are connected to the same two-pipe mains, the circuit flow may need to be mechanically balanced. After balancing, sufficient flow must be maintained in each one-pipe circuit to ensure adequate flow diversion to the loads.

When coupled with compound pumping systems, series circuits can be applied to multiple control zones on larger commercial or institutional systems (Figure 15). Note that in the series circuit with compound pumping, the load pumps need not be equal in capacity to the system pump. If, for

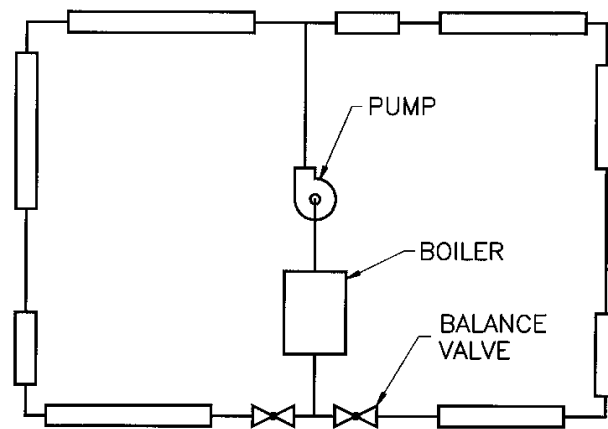


Fig. 13 Series Loop System

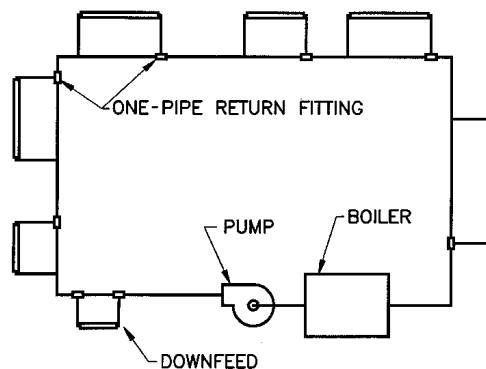


Fig. 14 One-Pipe Diverting Tee System

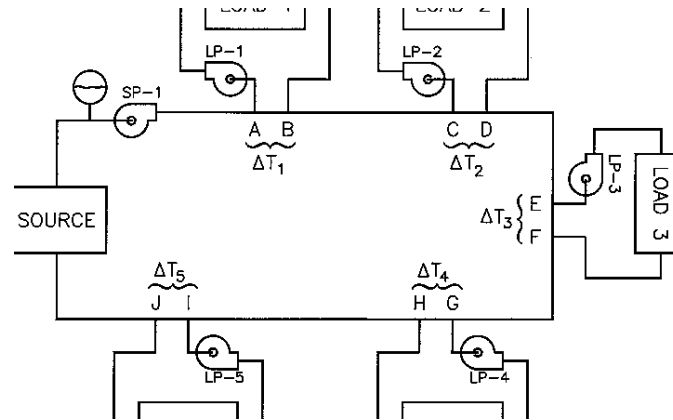


Fig. 15 Series Circuit with Load Pumps

example, load pump LP-1 circulates less flow (Q_{LP1}) than system pump SP-1 (Q_{SP1}), the temperature difference across Load 1 would be greater than the circuit temperature difference between A and B (i.e., water would flow in the common pipe from A to B). If, on the other hand, the load pump LP-2 is equal in flow capacity to the system pump SP-1, the temperature differentials across Load 2 and across the system from C to D would be equal and no water would flow in the common pipe. If Q_{LP3} exceeds Q_{SP1} , mixing occurs at Point E and, in a heating system, the temperature entering pump LP-3 would be lower than that available from the system leaving load connection D.

Thus, a series circuit using compound or load pumps offers many design options. Each of the loads shown in Figure 15 could also be a complete piping circuit or network.

Parallel Piping. These networks are the most commonly used in hydronic systems because they allow the same temperature water to be available to all loads. The two types of parallel networks are direct return and reverse return (Figure 16).

In the direct-return system, the length of supply and return piping through the subcircuits is unequal, which may cause unbalanced flow rates and require careful balancing to provide each subcircuit with design flow. Ideally, the reverse-return system provides nearly equal total lengths for all terminal circuits.

Direct-return piping has been successfully applied where the designer has guarded against major flow unbalance by

1. Providing for pressure drops in the subcircuits or terminals that are significant percentages of the total, usually establishing pressure drops for close subcircuits at higher values than those for the far subcircuits
2. Minimizing distribution piping pressure drop (In the limit, if the distribution piping loss is zero and the loads are of equal flow resistance, the system is inherently balanced.)
3. Including balancing devices and some means of measuring flow at each terminal or branch circuit
4. Using control valves with a high head loss at the terminals

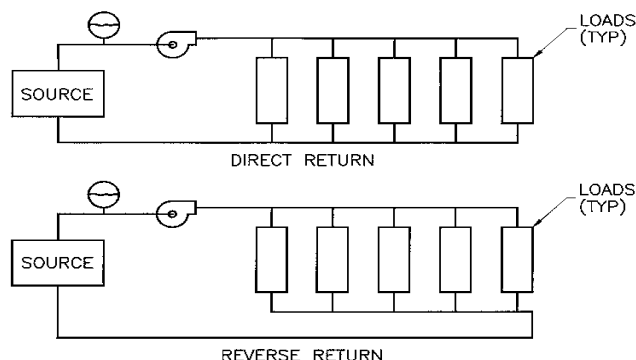


Fig. 16 Direct- and Reverse-Return Two-Pipe Systems

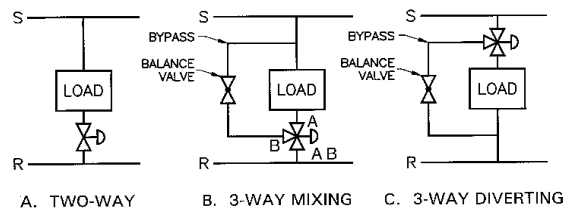


Fig. 17 Load Control Valves

CAPACITY CONTROL OF LOAD SYSTEM

The two alternatives for controlling the capacity of hydronic systems are on-off control and variable-capacity or modulating control. The on-off option is generally limited to smaller systems (e.g., residential or small commercial) and individual components of larger systems. In smaller systems where the entire building is a single zone, control is accomplished by cycling the source device (the boiler or chiller) on and off. Usually a space thermostat allows the chiller or boiler to run, then a water temperature thermostat (aquastat) controls the capacity of the chiller(s) or boiler(s) as a function of supply or return water temperature. The pump can be either cycled with the load device (usually the case in a residential heating system) or left running (usually done in commercial hot or chilled water systems).

In these single-zone applications, the piping design requires no special consideration for control. Where multiple zones of control are required, the various load devices are controlled first; then the source system capacity is controlled to follow the capacity requirement of the loads.

Control valves are commonly used to control loads. These valves control the capacity of each load by varying the amount of water flow through the load device when load pumps are not used. Control valves for hydronic systems are straight-through (two-way) valves and three-way valves (Figure 17). The effect of either valve is to vary the amount of water flowing through the load device.

With a two-way valve (Figure 17A), as the valve strokes from full-open to full-closed, the quantity of water flowing through the load gradually decreases from design flow to no flow. With a three-way mixing valve (Figure 17B) in one position, the valve is open from Port A to AB, with Port B closed off. In that position, all the flow is through the load. As the valve moves from the A-AB position to the B-AB position, some of the water bypasses the load by flowing through the bypass line, thus decreasing flow through the load. At the end of the stroke, Port A is closed, and all of the fluid will flow from B to AB with no flow through the load. Thus, the three-way mixing valve has the same effect on the load as the two-way valve—as the load reduces, the quantity of water flowing through the load decreases.

The effect on load control with the three-way diverting valve (Figure 17C) is the same as with the mixing valve in a closed system—the flow is either directed through the load or through the bypass in proportion to the load. Because of the dynamics of valve operation, diverting valves are more complex in design and are thus more expensive than mixing valves; because they accomplish the same function as the simpler mixing valve, they are seldom used in closed hydronic systems.

In terms of load control, a two-way valve and a three-way valve perform identical functions—they both vary the flow through the load as the load changes. The fundamental difference between the two-way valve and the three-way valve is that as the source or distribution system sees the load, the two-way valve provides a variable flow load response and the three-way valve provides a constant flow load response.

According to Equation (9), the load q is proportional to the product of Q and Δt . Ideally, as the load changes, Q changes, while Δt remains fixed. However, as the system sees it, as the load changes with the two-way valve, Q varies and Δt is fixed, whereas with a three-way valve, Δt varies and Q is fixed. This principle is illustrated in Figure 18. An understanding of this concept is fundamental to the design or analysis of hydronic systems.

The flow characteristics of two-way and three-way valve ports are described in Chapter 42, Automatic Control, of the 1995 *ASHRAE Handbook—Applications* and must be understood. The equal percentage characteristic is recommended for proportional control of the load flow for two-way and three-way valves; the bypass flow port of three-way valves should have the linear characteristic to maintain a uniform flow during part-load operation.

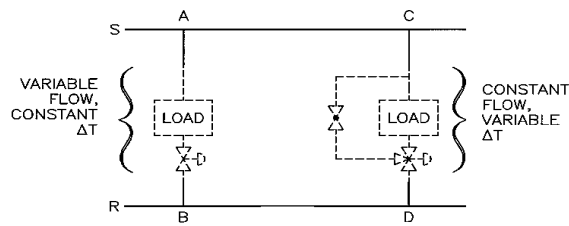


Fig. 18 System Flow with Two-Way and Three-Way Valves

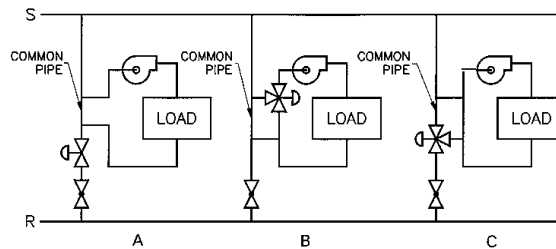


Fig. 19 Load Pumps with Valve Control

SIZING CONTROL VALVES

For stable control, the pressure drop in the control valve at the full-open position should be no less than one-half the pressure drop in the branch. For example, in Figure 18, the pressure drop at full-open position for the two-way valve should equal one-half the pressure drop from A to B, and for the three-way valve, the full-open pressure drop should be half that from C to D. The pressure drop in the bypass balancing valve in the three-way valve circuit should be set to equal that in the coil (load).

Control valves should be sized on the basis of the valve coefficient C_v . For more information, see the section on Control Valve Sizing in Chapter 41.

If a system is to be designed with multiple zones of control such that load response is to be by constant flow through the load and variable Δt , control cannot be achieved by valve control alone; a load pump is required.

Several control arrangements of load pump and control valve configurations are shown in Figure 19. Note that in all three configurations the common pipe has no restriction or check valve. In all configurations there is no difference in control as seen by the load. However, the basic differences in control are

1. With the two-way valve configuration (Figure 19A), the distribution system sees a variable flow and a constant Δt , whereas with both three-way configurations, the distribution system sees a constant flow and a variable Δt .

2. Configuration B differs from C in that the pressure required through the three-way valve in Figure 19B is provided by the load pump, while in Figure 19C it is provided by the distribution pump(s).

LOW-TEMPERATURE HEATING SYSTEMS

These systems are used for heating spaces or processes directly, as with standing radiation and process heat exchangers, or indirectly, through air-handling unit coils for preheating, for reheating, or in hot water unit heaters. These systems are generally designed with supply water temperatures from 180 to 240°F and temperature drops from 20 to 100°F.

In the United States, hot water heating systems were historically designed for a 200°F supply water temperature and a 20°F temperature drop. This practice evolved from earlier gravity system designs and provides convenient design relationships for heat transfer coefficients related to coil tubing and finned-tube radiation and for calculations (one gallon per minute conveys 10,000 Btu/h at 20°F Δt). Because many terminal devices still require these flow rates, it is important to recognize this relationship in selecting devices and designing systems.

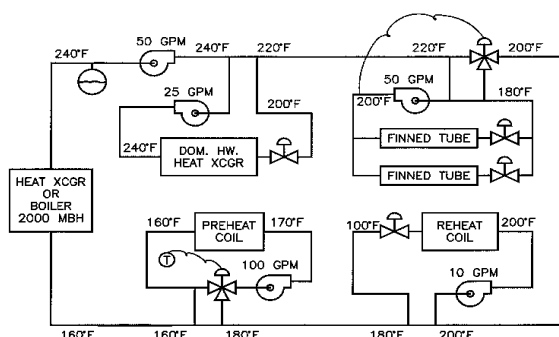


Fig. 20 Example of Series-Connected Loading

However, the greater the temperature range (and related lower flow rate) that can be applied, the less costly the system is to install and operate. A lower flow rate requires smaller and less expensive piping, less secondary building space, and smaller pumps. Also, smaller pumps require less energy, so operating costs are lower.

Nonresidential Heating Systems

Possible approaches to enhancing the economics of large heating systems include (1) higher supply temperatures, (2) primary-secondary pumping, and (3) terminal equipment designed for smaller flow rates. The three techniques may be used either singly or in combination.

Using higher supply water temperatures achieves higher temperature drops and smaller flow rates. Terminal units with a reduced heating surface can be used. These smaller terminals are not necessarily less expensive, however, because their required operating temperatures and pressures may increase manufacturing costs and the problems of pressurization, corrosion, expansion, and control. System components may not increase in cost uniformly with temperature, but rather in steps conforming to the three major temperature classifications. Within each classification, the most economical design uses the highest temperature in that classification.

Primary-secondary or compound pumping reduces the size and cost of the distribution system and also may use larger flows and lower temperatures in the terminal or secondary circuits. A primary pump circulates water in the primary distribution system while one or more secondary pumps circulate the terminal circuits. The connection between primary and secondary circuits provides complete hydraulic isolation of both circuits and permits a controlled interchange of water between the two. Thus, a high supply water temperature can be used in the primary circuit at a low flow rate and high temperature drop, while a lower temperature and conventional temperature drop can be used in the secondary circuit(s).

For example, a system could be designed with primary-secondary pumping in which the supply temperature from the boiler was 240°F, the supply temperature in the secondary was 200°F, and the return temperature was 180°F. This design results in a conventional 20°F Δt in the secondary zones, but permits the primary circuit to be sized on the basis of a 60°F drop. This primary-secondary pumping arrangement is most advantageous with terminal units such as convectors and finned radiation, which are generally unsuited for small flow rate design.

Many types of terminal heat transfer units are being designed to use smaller flow rates with temperature drops up to 100°F in low-temperature systems and up to 150°F in medium-temperature systems. Fan apparatus, the heat transfer surface used for air heating in fan systems, and water-to-water heat exchangers are most adaptable to such design.

A fourth technique is to put certain loads in series utilizing a combination of control valves and compound pumping (Figure 20). In the system illustrated, the capacity of the boiler or heat exchanger is 2×10^6 Btu/h, and each of the four loads is 0.5×10^6 Btu/h. Under design conditions, the system is designed for an 80°F water temperature drop, and the loads each provide 20°F of the total Δt . The loads in these systems, as well as the smaller or simpler systems in residential or commercial applications, can be connected in a direct-return or a reverse-return piping system. The different features of each load are as follows:

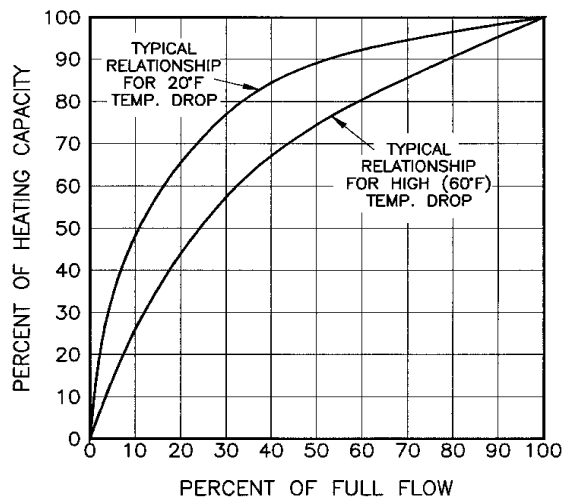


Fig. 21 Heat Emission Versus Flow Characteristic of Typical Hot Water Heating Coil

1. The domestic hot water heat exchanger has a two-way valve and is thus arranged for variable flow (while the main distribution circuit provides constant flow for the boiler circuit).
2. The finned-tube radiation circuit is a 20°F Δt circuit with the design entering water temperature reduced to and controlled at 200°F.
3. The reheat coil circuit takes a 100°F temperature drop for a very low flow rate.
4. The preheat coil circuit provides constant flow through the coil to keep it from freezing.

When loads such as water-to-air heating coils in LTW systems are valve controlled (flow varies), they have a heating characteristic of flow versus capacity as shown in Figure 21 for 20°F and 60°F temperature drops. For a 20°F Δt coil, 50% flow provides approximately 90% capacity; valve control will tend to be unstable. For this reason, proportional temperature control is required, and equal percentage characteristic two-way valves should be selected such that 10% flow is achieved with 50% valve lift. This combination of the valve characteristic and the heat transfer characteristic of the coil makes the control linear with respect to the control signal. This type of control can be obtained only with equal percentage two-way valves and can be further enhanced if piped with a secondary pump arrangement as shown in Figure 19A. See Chapter 42 of the 1995 *ASHRAE Handbook—Applications* for further information on automatic controls.

CHILLED WATER SYSTEMS

Designers have less latitude in selecting supply water temperatures for cooling applications because there is only a narrow range of water temperatures low enough to provide adequate dehumidification and high enough to avoid chiller freeze-up. Circulated water quantities can be reduced by selecting proper air quantities and heat transfer surface at the terminals. Terminals suited for a 12°F rise rather than an 8°F rise reduce circulated water quantity and pump power by one-third and increase chiller efficiency.

A proposed system should be evaluated for the desired balance between installation cost and operating cost. Table 1 shows the effect of coil circuiting and chilled water temperature on water flow and temperature rise. The coil rows, fin spacing, air-side performance, and cost are identical for all selections. Morabito (1960) showed how such changes in coil circuiting affect the overall system. Considering the investment cost of piping and insulation versus the operating cost of refrigeration and pumping motors, higher temperature rises, (i.e., 16 to 24°F temperature rise at about 1.0 to 1.5 gpm per ton of cooling) can be applied on chilled water systems with long distribution piping runs; larger flow rates should be used only where reasonable in close-coupled systems.

For the most economical design, the minimum flow rate to each terminal heat exchanger is calculated. For example, if one terminal can be designed for an 18°F rise, another for 14°F, and

Table 1 Chilled Water Coil Performance

Coil Circuiting	Chilled Water Inlet Temp., °F	Coil Pressure Drop, psi	Chilled Water Flow, gpm/ton	Chilled Water Temp. Rise, °F
Full ^a	45	1.0	2.2	10.9
Half ^b	45	5.5	1.7	14.9
Full ^a	40	0.5	1.4	17.1
Half ^b	40	2.5	1.1	21.8

Note: Table is based on cooling air from 81°F dry bulb, 67°F wet bulb to 58°F dry bulb, 56°F wet bulb.

^aFull circuiting (also called single circuit). Water at the inlet temperature flows simultaneously through all tubes in a plane transverse to airflow; it then flows simultaneously through all tubes, in unison, in successive planes (i.e., rows) of the coil.

^bHalf circuiting. Tube connections are arranged so there are half as many circuits as there are tubes in each plane (row) thereby using higher water velocities through the tubes. This circuiting is used with small water quantities.

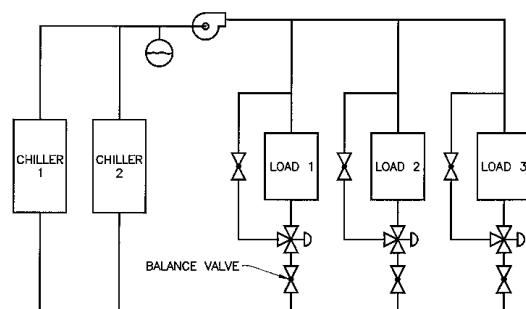


Fig. 22 Constant Flow Chilled Water System

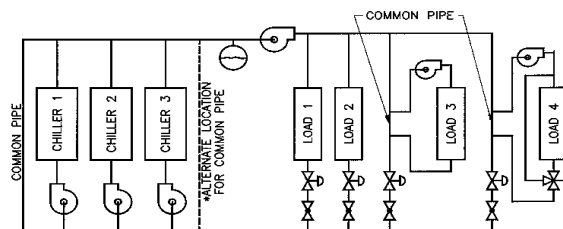


Fig. 23 Variable Flow Chilled Water System

others for 12°F, the highest rise to each terminal should be used, rather than designing the system for an overall temperature rise based on the smallest capability.

The control system selected also influences the design water flow. For systems using multiple terminal units, diversity factors can be applied to flow quantities before sizing pump and piping mains if exposure or use prevents the unit design loads from occurring simultaneously and if two-way valves are used for water flow control. If air-side control (e.g. face-and-bypass or fan cycling) or three-way valves on the water side are used, diversity should not be a consideration in pump and piping design, although it should be considered in the chiller selection.

A primary consideration with chilled water system design is the control of the source systems at reduced loads. The constraints on the temperature parameters are (1) a water freezing temperature of 32°F, (2) economics of the refrigeration system in generating chilled water, and (3) the dew-point temperature of the air at nominal indoor comfort conditions (55°F dew point at 75°F and 50% rh). These parameters have led to the common practice of designing for a supply chilled water temperature of 44 to 45°F and a return water temperature between 55 and 64°F.

Historically, most chilled water systems have used three-way control valves to achieve constant water flow through the chillers. However, as systems have become larger, as designers have turned to multiple chillers for reliability and controllability, and as energy economics have become an increasing concern, the use of two-way valves and source pumps for the chillers has greatly increased.

A typical configuration of a small chilled water system using two parallel chillers and loads with three-way valves is illustrated in Figure 22. Note that the flow is essentially constant. A simple energy balance [Equation (9)] dictates that with a constant flow rate, at one-half of design load, the water temperature differential drops to one-half of design. At this load, if one of the chillers is turned off, the return water circulating through the off chiller mixes with the supply water. This mixing raises the temperature of the supply chilled water and can cause a loss of control if the designer does not consider this operating mode.

A typical configuration of a large chilled water system with multiple chillers and loads and compound piping is shown in Figure 23. This system provides variable flow, essentially constant supply temperature chilled water, multiple chillers, more stable two-way control valves, and the advantage of adding chilled water storage with little additional complexity.

One design issue illustrated in Figure 23 is the placement of the common pipe for the chillers. With the common pipe as shown, the chillers will unload from left to right. With the common pipe in the alternate location shown, the chillers will unload equally in proportion to their capacity (i.e., equal percentage).

DUAL-TEMPERATURE SYSTEMS

Dual-temperature systems are used when the same load devices and distribution systems are used for both heating and cooling (e.g., fan-coil units and central station air-handling unit coils). In the design of dual-temperature systems, the cooling cycle design usually dictates the requirements of the load heat exchangers and distribution systems. Dual-temperature systems are basically of three different configurations, each requiring different design techniques:

1. Two-pipe systems
2. Four-pipe common load systems
3. Four-pipe independent load systems

Two-Pipe Systems

In a two-pipe system, the load devices and the distribution system circulate chilled water when cooling is required and hot water when heating is required (Figure 24). Design considerations for these systems include the following:

- Loads must all require cooling or heating coincidentally; that is, if cooling is required for some loads and heating for other loads at a given time, this type of system should not be used.
- When designing the system, the flow and temperature requirements for both the cooling and the heating media must be calculated first. The load and distribution system should be designed for the more stringent, and the water temperatures and temperature differential should be dictated by the other mode.
- The changeover procedure should be designed such that the chiller evaporator is not exposed to damaging high water temperatures and the boiler is not subjected to damaging low water temperatures. To accommodate these limiting requirements, the changeover of a system from one mode to

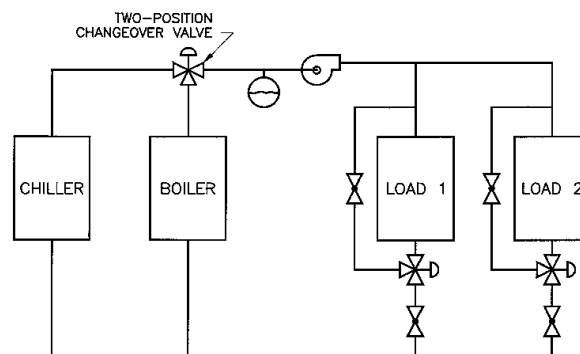


Fig. 24 Simplified Diagram of Two-Pipe System

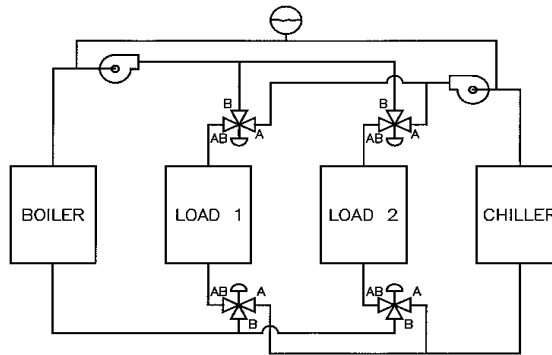


Fig. 25 Four-Pipe Common Load System

the other requires considerable time. If rapid load swings are anticipated, a two-pipe system should not be selected, although it is the least costly of the three options.

Four-Pipe Common Load Systems

In the four-pipe common load system, load devices are used for both heating and cooling as in the two-pipe system. The four-pipe common load system differs from the two-pipe system in that both heating and cooling are available to each load device, and the changeover from one mode to the other takes place at each individual load device, or grouping of load devices, rather than at the source. Thus, some of the load systems can be in the cooling mode while others are in the heating mode. Figure 25 is a flow diagram of a four-pipe common load system, with multiple loads and a single boiler and chiller.

Although many of these systems have been installed, many have not performed successfully due to problems in implementing the design concepts.

One problem that must be addressed is the expansion tank connection(s). Many four-pipe systems were designed with two expansion tanks—one for the cooling circuit and one for the heating circuit. However, with multiple loads, these circuits become hydraulically interconnected, thus creating a system with two expansion chambers. The preferred method of handling the expansion tank connection sets the point of reference pressure equal in both circuits (Figure 25).

Another potential problem is the mixing of hot and chilled water. At each load connection, two three-way valves are required—a mixing valve on the inlet and a diverting valve on the outlet. These valves operate in unison in just two positions—opening either Port B to AB or Port A to AB. If, for example, the valve on the outlet does not seat tightly and Load 1 is indexed to cooling and Load 2 is indexed to heating, return heating water from Load 2 will flow into the chilled water circuit, and return chilled water from Load 1 will flow into the heating water circuit. The probability of this occurring increases as the number of loads increases because the number of control valves increases.

Another disadvantage of this system is that the loads have no individual capacity control as far as the water system is concerned. That is, each valve must be positioned to either full heating or full cooling with no control in between.

Because of these disadvantages, four-pipe common load systems should be limited to those applications in which there are no independent load circuits (i.e., radiant ceiling panels or induction unit coils).

Four-Pipe Independent Load Systems

The four-pipe independent load system is preferred for those hydronic applications in which some of the loads are in the heating mode while others are in the cooling mode. Control is simpler and more reliable than for the common load systems, and in many applications, the four-pipe independent load system is less costly to install. Also, the flow through the individual loads can be modulated, providing both the control capability for variable capacity and the opportunity for variable flow in either or both circuits.

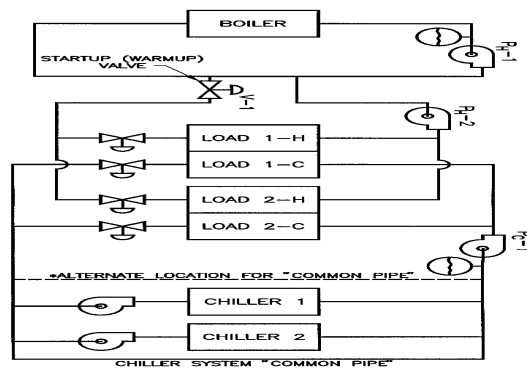


Fig. 26 Four-Pipe Independent Load System

A simplified example of a four-pipe independent load system with two loads, one boiler, and two chillers is shown in Figure 26. Note that both hydronic circuits are essentially independent, so that each can be designed with disregard for the other system. Although both circuits in the figure are shown as variable flow distribution systems, they could be constant flow (three-way valves) or one variable flow and one constant flow. Generally, the control modulates the two load valves in sequence with a dead band at the control midpoint.

This type of system offers additional flexibility when some selective loads are arranged for heating only or cooling only, such as unit heaters or preheat coils. Then, central station systems can be designed for humidity control with reheat through configuration at the coil locations and with proper control sequences.

OTHER DESIGN CONSIDERATIONS

Makeup and Fill Water Systems

Generally, a hydronic system is filled with water through a valved connection to a domestic water source, with a service valve, a backflow preventer, and a pressure gage. (The domestic water source pressure must exceed the system fill pressure.)

Because the expansion chamber is the reference pressure point in the system, the water makeup point is usually located at or near the expansion chamber.

Many designers prefer to install automatic makeup valves, which consist of a pressure-regulating valve in the makeup line. However, the quantity of water being made up must be monitored to avoid scaling and oxygen corrosion in the system.

Safety Relief Valves

Safety relief valves should be installed at any point at which pressures can be expected to exceed the safe limits of the system components. Causes of excessive pressures include

- Overpressurization from fill system
- Pressure increases due to thermal expansion
- Surges caused by momentum changes (shock or water hammer)

Overpressurization from the fill system could occur due to an accident in filling the system or due to the failure of an automatic fill regulator. To prevent this, a safety relief valve is usually installed at the fill location. Figure 27 shows a typical piping configuration for a system with a plain steel or air/water interface expansion tank. Note that no valves are installed between the hydronic system piping and the safety relief valve. This is a mandatory design requirement if the valve in this location is also to serve as a protection against pressure increases due to thermal expansion.

An expansion chamber is installed in a hydronic system, to allow for the volumetric changes that accompany water temperature changes. However, if any part of the system is configured such that it can be isolated from the expansion tank and its temperature can increase while it is isolated, then overpressure relief should be provided.

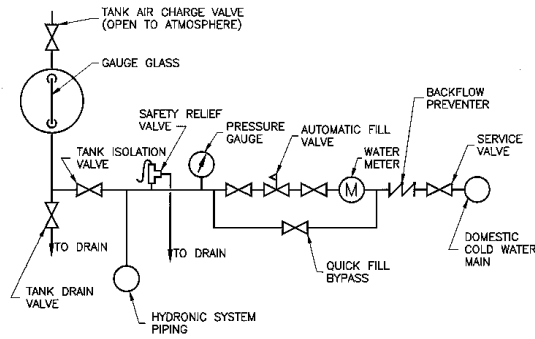


Fig. 27 Typical Makeup Water and Expansion Tank Piping Configuration for Plain Steel Expansion Tank

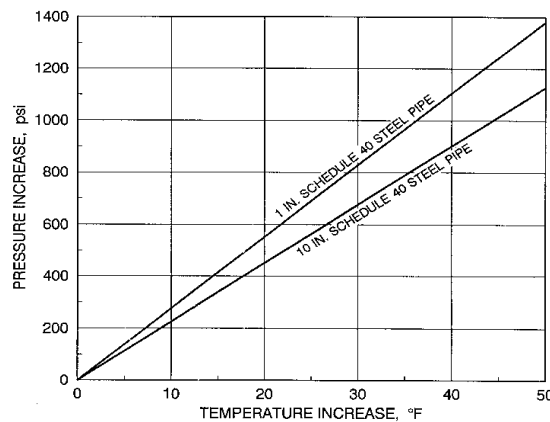


Fig. 28 Pressure Increase Resulting from Thermal Expansion as Function of Temperature Increase

The relationship between pressure change due to temperature change and the temperature change in a piping system is expressed by the following equation:

$$\Delta p = \frac{(\beta - 3\alpha)\Delta t}{(5/4)(D/E\Delta r) + \gamma} \quad (17)$$

where

Δp = pressure increase, psi

β = volumetric coefficient of thermal expansion of water, $1/^\circ\text{F}$

α = linear coefficient of thermal expansion for piping material, $1/^\circ\text{F}$

Δt = water temperature increase, $^\circ\text{F}$

D = pipe diameter, in.

E = modulus of elasticity of piping material, psi

γ = volumetric compressibility of water, in^2/lb

Δr = thickness of pipe wall, in.

Figure 28 shows a solution to Equation (17) demonstrating the pressure increase caused by any given temperature increase for 1 in. and 10 in. steel piping. If the temperature in a chilled water system with piping spanning sizes between 1 and 10 in. were to increase by 15°F , the pressure would increase between 340 and 420 psi, depending on the average pipe size in the system.

Safety relief should be provided to protect boilers, heat exchangers, cooling coils, chillers, and the entire system when the expansion tank is isolated for air charging or other service. As a minimum, the ASME Boiler Code requires that a dedicated safety relief valve be installed on each boiler and that isolating or service valves be provided on the supply and return connections to each boiler.

Potential forces caused by shock waves or water hammer should also be considered in design. Chapter 33 of the 1993 *ASHRAE Handbook—Fundamentals* discusses the causes of shock forces and the methodology for calculating the magnitude of these forces.

Air Elimination

If air and other gases are not eliminated from the flow circuit, they may cause binding in the terminal heat transfer elements, corrosion, noise, reduced pumping capacity, and loss of hydraulic stability (see the section on Principles). A closed tank without a diaphragm can be installed at the point of the lowest solubility of air in water. When a diaphragm tank is used, air in the system can be removed by an air separator and air elimination valve installed at the point of lowest solubility. Manual vents should be installed at high points to remove all trapped air during initial operation and to ensure that the system is tight. Shutoff valves should be installed on any automatic air removal device to permit servicing without draining the system.

Drain and Shutoff

All low points should have drains. Separate shutoff and draining of individual equipment and circuits should be possible so that the entire system does not have to be drained to service a particular item. Whenever a device or section of the system is isolated, and the water in that section or device could increase in temperature following isolation, overpressure safety relief protection must be provided.

Balance Fittings

Balance fittings or valves and a means of measuring flow quantity should be applied as needed to permit balancing of individual terminals and subcircuits.

Pitch

Piping need not pitch but can run level, providing that flow velocities exceeding 1.5 fps are maintained or a diaphragm tank is used.

Strainers

Strainers should be used where necessary to protect system elements. Strainers in the pump suction must be checked carefully to avoid cavitation. Large separating chambers can serve as main air venting points and dirt strainers ahead of pumps. Automatic control valves or other devices operating with small clearances require protection from pipe scale, gravel, and welding slag, which may readily pass through the pump and its protective separator. Individual fine mesh strainers may therefore be required ahead of each control valve.

Thermometers

Thermometers or thermometer wells should be installed to assist the system operator in routine operation and troubleshooting. Permanent thermometers, with the correct scale range and separate sockets, should be used at all points where temperature readings are regularly needed. Thermometer wells should be installed where readings will be needed only during start-up and infrequent troubleshooting. If a central monitoring system is provided, a calibration well should be installed adjacent to each sensing point in insulated piping systems.

Flexible Connectors and Expansion Compensation

Flexible connectors are sometimes installed at pumps and machinery to reduce pipe stress. See Chapter 43 of the 1995 *ASHRAE Handbook—Applications* for vibration isolation information. Expansion, flexibility, and hanger and support information is in Chapter 40 of this volume.

Gage Cocks

Gage cocks or quick-disconnect test ports should be installed at points requiring pressure readings. Gages permanently installed in the system will deteriorate because of vibration and

pulsation and will, therefore, be unreliable. It is good practice to install gage cocks and provide the operator with several quality gages for diagnostic purposes.

Insulation

Insulation should be applied to minimize pipe thermal loss and to prevent condensation during chilled water operation (see Chapter 20 of the 1993 *ASHRAE Handbook—Fundamentals*). On chilled water systems, special rigid metal sleeves or shields should be installed at all hanger and support points, and all valves should be provided with extended bonnets to allow for the full insulation thickness without interference with the valve operators.

Condensate Drains

Condensate drains from dehumidifying coils should be trapped and piped to an open-sight plumbing drain. Traps should be deep enough to overcome the air pressure differential between drain inlet and room, which ordinarily will not exceed 2 in. of water. Pipe should be noncorrosive and insulated to prevent moisture condensation. Depending on the quantity and temperature of condensate, plumbing drain lines may require insulation to prevent sweating.

Common Pipe

In compound (primary-secondary) pumping systems, the common pipe is used to dynamically decouple the two pumping circuits. Ideally, there is no pressure drop in this section of piping; however, in actual systems, it is recommended that this section of piping be a minimum of 10 diameters in length to reduce the likelihood of unwanted mixing resulting from velocity (kinetic) energy or turbulence.

DESIGN PROCEDURES

Preliminary Equipment Layout

Flows in Mains and Laterals. Regardless of the method used to determine the flow through each item of terminal equipment, the desired result should be listed in terms of mass flow on the preliminary plans or in a schedule of flow rates for the piping system. (In the design of small systems and chilled water systems, the determination may be made in terms of volumetric flow).

In an equipment schedule or on the plans, starting from the most remote terminal and working toward the pump, progressively list the cumulative flow in each of the mains and branch circuits in the distribution system.

Preliminary Pipe Sizing. For each portion of the piping circuit, select a tentative pipe size from the unified flow chart (Figure 1 in Chapter 33 of the 1993 *ASHRAE Handbook—Fundamentals*), using a value of pipe friction loss ranging from 0.75 to 4 ft per 100 ft (approximately 0.1 to 0.5 in/ft).

Residential piping size is often based on pump preselection using pipe sizing tables, which are available from the Hydronics Institute or from manufacturers.

Preliminary Pressure Drop. Using the preliminary pipe sizing indicated above, determine the pressure drop through each portion of the piping. The total pressure drop in the longest circuits determines the maximum pressure drop through the piping, including the terminals and control valves, that must be available in the form of pump pressure.

Preliminary Pump Selection. The preliminary selection should be based on the pump's ability to fulfill the determined capacity requirements. It should be selected at a point left of center on the pump curve and should not overload the motor. Because pressure drop in a flow system varies as the square of the flow rate, the flow variation between the nearest size of stock pump and an exact point selection will be relatively minor.

Final Pipe Sizing and Pressure Drop Determination

Final Piping Layout. Examine the overall piping layout to determine whether pipe sizes in some areas need to be readjusted. Several principal circuits should have approximately equal pressure drops so that excessive pressures are not needed to serve a small portion of the building.

Consider both the initial costs of the pump and piping system and the pump's operating cost when determining final system friction loss. Generally, lower heads and larger piping are more economical when longer amortization periods are considered, especially in larger systems. However, in small systems such as in residences, it may be most economical to select the pump first and design the piping system to meet the available pressure. In all cases, adjust the piping system design and pump selection until the optimum design is found.

Final Pressure Drop. When the final piping layout has been established, determine the friction loss for each section of the piping system from the pressure drop charts (Chapter 33 of the 1993 *ASHRAE Handbook—Fundamentals*) for the mass flow rate in each portion of the piping system.

After calculating the friction loss at design flow for all sections of the piping system and all fittings, terminal units, and control valves, sum them for several of the longest piping circuits to determine the pressure against which the pump must operate at design flow.

Final Pump Selection. After completing the final pressure drop calculations, select the pump by plotting a system curve and pump curve and selecting the pump or pump assembly that operates closest to the calculated design point.

Freeze Prevention

All circulating water systems require precautions to prevent freezing, particularly in makeup air applications in temperate climates (1) where coils are exposed to outdoor air at below-freezing temperatures, (2) where undrained chilled water coils are in the winter airstream, or (3) where piping passes through unheated spaces. Freezing will not occur as long as flow is maintained and the water is at least warm. Unfortunately, during extremely cold weather or in the event of a power failure, water flow and temperature cannot be guaranteed. Additionally, continuous pumping can be energy-intensive and cause system wear. The following are precautions to avoid flow stoppage or damage from freezing:

1. Select all load devices (such as preheat coils) that are subjected to outdoor air temperatures for constant flow, variable Δt control.
2. Position the coil valves of all cooling coils with valve control that are dormant in winter months to the full-open position at those times.
3. If intermittent pump operation is used as an economy measure, use an automatic override to operate both chilled water and heating water pumps in below-freezing weather.
4. Select pump starters that automatically restart after power failure (i.e., maintain contact control).
5. Select nonoverloading pumps.
6. Instruct operating personnel never to shut down pumps in subfreezing weather.
7. Do not use aquastats, which can stop a pump, in boiler circuits.
8. Avoid sluggish circulation, which may cause air binding or dirt deposit. Properly balance and clean systems. Provide proper air control or means to eliminate air.
9. Install low temperature detection thermostats that have phase change capillaries wound in a serpentine pattern across the leaving face of the upstream coil.

In fan equipment handling outdoor air, take precautions to avoid stratification of air entering the coil. The best methods for proper mixing of indoor and outdoor air are the following:

1. Select dampers for pressure drops adequate to provide stable control of mixing, preferably with dampers installed several equivalent diameters upstream of the air-handling unit.
2. Design intake and approach duct systems to promote natural mixing.
3. Select coils with circuiting to allow parallel flow of air and water.

Freeze-up may still occur with any of these precautions. If an antifreeze solution is not used, water should circulate at all times. Valve-controlled elements should have low-limit thermostats, and sensing elements should be located to ensure accurate air temperature readings. Primary-secondary pumping of coils with three-way valve injection (as in Figures 19B and 19C) is advantageous. Use outdoor reset of water temperature wherever possible.

ANTIFREEZE SOLUTIONS

In systems in danger of freeze-up, water solutions of ethylene glycol and propylene glycol are commonly used. Freeze protection may be needed (1) in snow-melting applications (see Chapter 46 of the 1995 *ASHRAE Handbook—Applications*); (2) in systems subjected to 100% outdoor air, where the methods outlined above may not provide absolute antifreeze protection; (3) in isolated parts or zones of a heating system where intermittent operation or long runs of exposed piping increase the danger of freezing; and (4) in process cooling applications requiring temperatures below 40°F. Although using ethylene glycol or propylene glycol is comparatively expensive and tends to create corrosion problems unless suitable inhibitors are used, it may be the only practical solution in many cases.

Solutions of triethylene glycol, as well as certain other heat transfer fluids, may also be used. However, ethylene glycol and propylene glycol are the most common substances used in hydronic systems because they are less costly and provide the most effective heat transfer.

Heat Transfer and Flow

Table 6, Table 7, Table 8, Table 9, Table 10, Table 11, Table 12 and 13 and Figures 9 through 16 in Chapter 18 of the 1993 *ASHRAE Handbook—Fundamentals* show density, specific heat, thermal conductivity, and viscosity of various aqueous solutions of ethylene glycol and propylene glycol. Table 4 and Table 5 of that chapter indicate the freezing points for the two solutions.

System heat transfer rate is affected by relative density and specific heat according to the following equation:

$$q_w = 500Q(\rho/\rho_w)c_p\Delta t \quad (18)$$

where

q_w = total heat transfer rate, Btu/h

Q = flow rate, gpm

ρ = fluid density, lb/ft³

ρ_w = density of water at 60°F, lb/ft³

c_p = specific heat of fluid, Btu/lb·°F

Δt = temperature increase or decrease, °F

Effect on Heat Source or Chiller

Generally, ethylene glycol solutions should not be used directly in a boiler because of the danger of chemical corrosion caused by glycol breakdown on direct heating surfaces. However, properly inhibited glycol solutions can be used in low-temperature water systems directly in the heating boiler if proper operation can be ensured. Automobile antifreeze solutions are not recommended because the silicate inhibitor can cause fouling, pump seal wear, fluid gelation, and reduced heat transfer. The area or zone requiring the antifreeze protection can be isolated with a separate heat exchanger or converter. Glycol solutions are used directly in water chillers in many cases.

Glycol solutions affect the output of a heat exchanger by changing the film coefficient of the surface contacting the solution. This change in film coefficient is caused primarily by viscosity changes. Figure 29 illustrates typical changes in output for two types of heat exchangers, Curve A for a steam-to-liquid converter and Curve B for a refrigerant-to-liquid chiller. The curves are plotted for one set of operating conditions only and reflect the change in ethylene glycol concentration as the only variable. Propylene glycol has a similar effect on heat exchanger output.

Because many other variables, such as liquid velocity, steam or refrigerant loading, temperature difference, and unit construction affect the overall coefficient of a heat exchanger, designers should consult manufacturers' ratings when selecting such equipment. The curves indicate only the magnitude of these output changes.

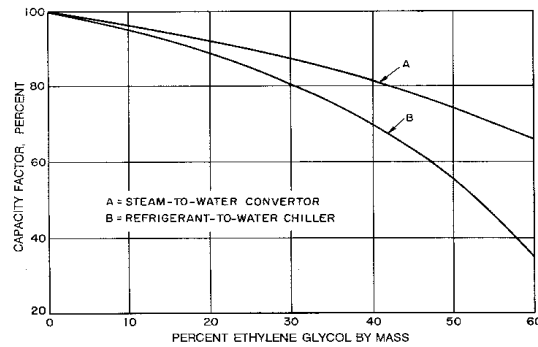


Fig. 29 Example of Effect of Aqueous Ethylene Glycol Solutions on Heat Exchanger Output

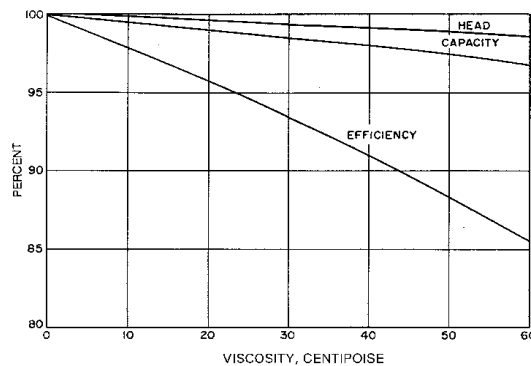


Fig. 30 Effect of Viscosity on Pump Characteristics

Effect on Terminal Units

Because the effect of glycol on the capacity of terminal units may vary widely with temperature, the manufacturer's rating data should be consulted when selecting heating or cooling units in glycol systems.

Effect on Pump Performance

Centrifugal pump characteristics are affected to some degree by glycol solutions because of viscosity changes. Figure 30 shows these effects on pump capacity, head, and efficiency. Figures 12 and 16 in Chapter 18 of the 1993 *Handbook—Fundamentals* plot the viscosity of aqueous ethylene glycol and propylene glycol. Centrifugal pump performance is normally cataloged for water at 60 to 80°F. Hence, absolute viscosity effects below 1.1 centipoise can safely be ignored as far as pump performance is concerned. In intermittently operated systems, such as snow-melting applications, viscosity effects at start-up may decrease flow enough to slow pickup.

Effect on Piping Pressure Loss

The friction loss in piping also varies with viscosity changes. Figure 31 gives correction factors for various ethylene glycol and propylene glycol solutions. These factors are applied to the calculated pressure loss for water [Equation (17)]. No correction is needed for ethylene glycol and propylene glycol solutions above 160°F.

Installation and Maintenance

Because glycol solutions are comparatively expensive, the smallest possible concentrations to produce the desired antifreeze properties should be used. The total water content of the system should be calculated carefully to determine the required amount of glycol (Craig et al. 1993). The

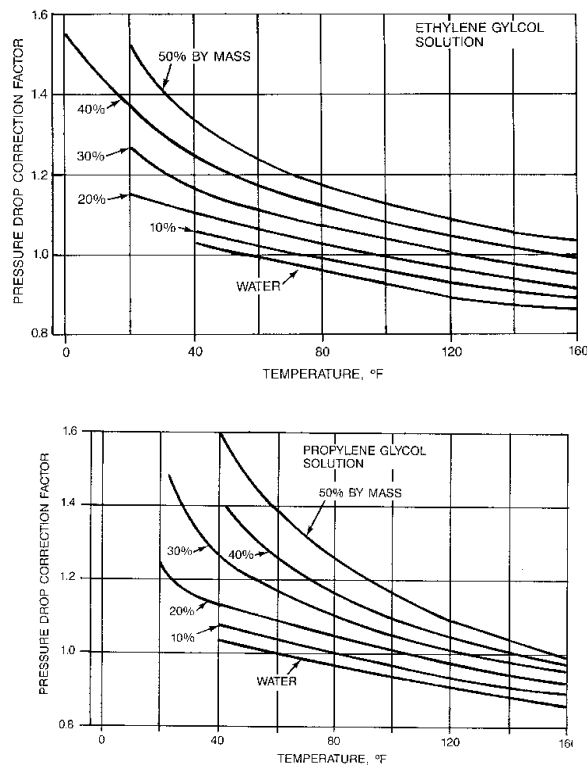


Fig. 31 Pressure Drop Correction for Glycol Solutions

solution can be mixed outside the system in drums or barrels and then pumped in. Air vents should be watched during filling to prevent loss of solution. The system and the cold water supply should not be permanently connected, so automatic fill valves are usually not used.

Ethylene glycol and propylene glycol normally include an inhibitor to help prevent corrosion. Solutions should be checked each year using a suitable refractometer to determine glycol concentration. Certain precautions regarding the use of inhibited ethylene glycol solutions should be taken to extend their service life and to preserve equipment:

1. Before injecting the glycol solution, thoroughly clean and flush the system.
2. Use waters that are soft and low in chloride and sulfate ions to prepare the solution whenever possible.
3. Limit the maximum operating temperature to 250°F in a closed hydronic system. In a heat exchanger, limit glycol film temperatures to 300 to 350°F (steam pressures 120 psi or less) to prevent deterioration of the solution.
4. Check the concentration of inhibitor periodically, following procedures recommended by the glycol manufacturer.

REFERENCES

- ASME. 1995. *Boiler and Pressure Vessel Codes*. American Society of Mechanical Engineers, New York.
- Carlson, G.F. 1981. The design influence of air on hydronic systems. *ASHRAE Transactions* 87(1):1293-1300.
- Coad, W.J. 1980a. Air in hydronic systems. *Heating/Piping/Air Conditioning* (July).
- Coad, W.J. 1980b. Expansion tanks. *Heating/Piping/Air Conditioning* (May).
- Coad, W.J. 1985. Variable flow in hydronic systems for improved stability, simplicity, and energy economics. *ASHRAE Transactions* 91(1B):224-37.
- Craig, N.C., B.W. Jones, and D.L. Fenton. 1993. Glycol concentration requirements for freeze burst protection. *ASHRAE Transactions* 99(2):200-09
- Himmelblau, D.M. 1960. Solubilities of inert gases in water. *Journal of Chemical and Engineering Data* 5(1).

Hull, R.F. 1981. Effect of air on hydraulic performance of the HVAC system. *ASHRAE Transactions* 87(1):1301-25.

Lockhart, H.A. and G.F. Carlson. 1953. Compression tank selection for hot water heating systems. *ASHVE Journal* 25(4):132-39. Also in *ASHVE Transactions* 59:55-76.

Morabito, B.P. 1960. How higher cooling coil differentials affect system economics. *ASHRAE Journal* 2(8):60.

Pierce, J.D. 1963. Application of fin tube radiation to modern hot water heating systems. *ASHRAE Journal* 5(2):72.

Pompei, F. 1981. Air in hydronic systems: How Henry's law tells us what happens. *ASHRAE Transactions* 87(1):1326-42.

Stewart, W.E. and C.L. Dona. 1987. Water flow rate limitations. *ASHRAE Transactions* 93(2):811-25.